


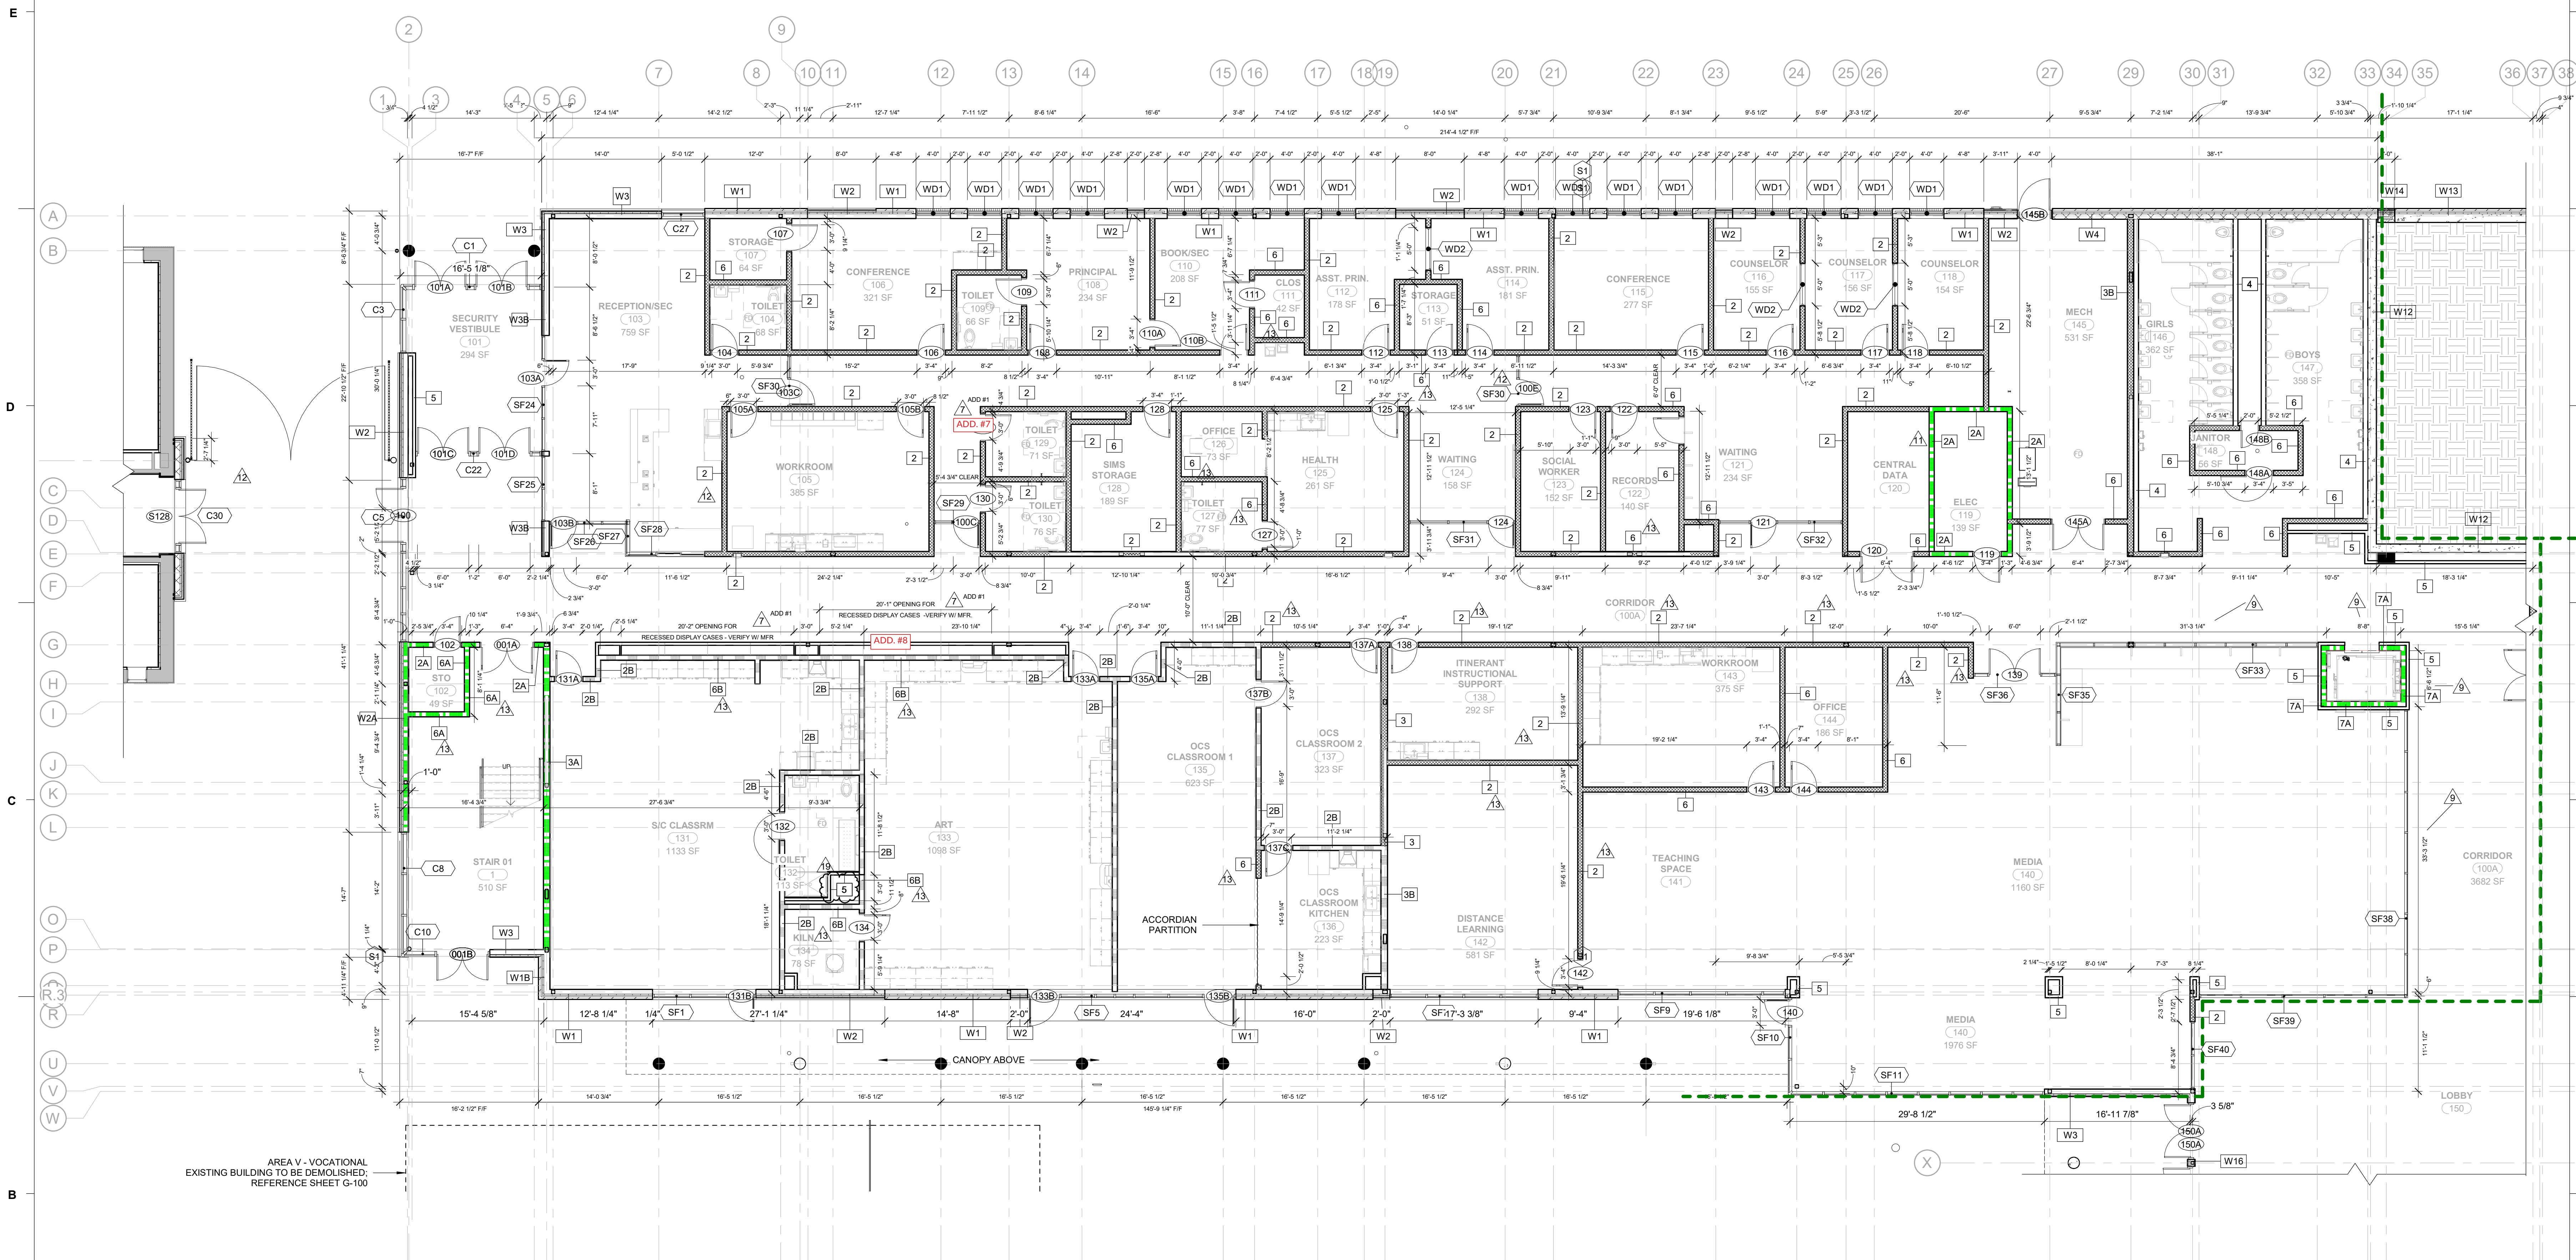

(A1) DIMENSION FLOOR PLAN - LEVEL 1 - AREA A
1/8" = 1'-0"

DIMENSION PLAN SHEET NOTES

- EXTERIOR DIMENSIONS AT MASONRY VENEER ARE TO FACE OF VENEER.
- EXTERIOR DIMENSIONS AT STUD WALLS ARE TO FACE OF VENEER.
- INTERIOR DIMENSIONS INDICATED ARE TO (FACE OF CMU, FACE OF STUD, PARTITION CENTERLINE) AND CENTERLINES OF COLUMNS, UNO.
- LOCATE DOOR OPENINGS 4" FROM NEAREST PERPENDICULAR WALL.
- FIRE RATED WALLS/PARTITIONS TO BE CONSTRUCTED TIGHT TO STRUCTURE, PIPING, DUCTWORK AND OTHER PENETRATIONS. ALL WORK IS TO BE BRACED TO STRUCTURE ABOVE.
- WHERE PARTITIONS OF DIFFERENT FIRE RATINGS INTERSECT, THE HIGHEST RATED PARTITION SHALL CONTINUE THROUGH. MAINTAIN PARTITION FIRE RATING BEHIND RECESSED FIRE EXTINGUISHER CABINETS.
- SEE ENLARGED PLANS FOR ADDITIONAL DIMENSIONS AND PARTITION TYPES.
- SEE STRUCTURAL DRAWINGS FOR SLAB DEPRESSIONS AND CUTOUTS.
- SEE BUILDING ELEVATION DRAWINGS FOR LOCATION OF EXTERIOR MASONRY CONTROL JOINTS.

RATED WALLS & PARTITION LEGEND


- 1 HR. RATED FIRE BARRIER TO DECK
- 2 HR. RATED FIRE WALL
- SMOKE PARTITION TO DECK
- NON-RATED PARTITION TO CEILING
- NON-RATED PARTITION TO DECK

NOTE: SEE SHEET A-1003 FOR CONSTRUCTION OF PARTITION TYPES.

PARTITION NOTES

- ALL NON-DESIGNATED PARTITIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT.
- ALL PIPE AND CONDUIT PENETRATIONS THRU RATED PARTITIONS, FLOORS, ROOF, ETC. SHALL BE SEALED WITH A RESPECTIVELY RATED FIRE BARRIER PENETRATION SEALING SYSTEM BY 3M OR U.L. APPROVED EQUAL.
- TILE BACKER BOARD SHALL BE USED IN ALL LOCATIONS TO RECEIVE TILE FINISHES. REFER TO FINISH SCHEDULE AND INTERIOR ELEVATIONS FOR LOCATIONS.
- CONTRACTOR SHALL COORDINATE WITH MECHANICAL DUCTWORK PRIOR TO FABRICATION OF PARTITION WALLS.
- SHOULD CONDITIONS OCCUR WHERE A WALL IS UNABLE TO GO STRAIGHT UP TO STRUCTURE DUE TO PIPING, DUCTWORK, ETC., THE PARTITION (GYPSUM BOARD AND FRAMING) MAY JOG HORIZONTALLY ABOVE THE CEILING TO AVOID THE PROBLEM. RATED WALL INTEGRITY SHALL BE MAINTAINED.
- DIMENSIONAL CONFLICTS BETWEEN PARTITION TYPES AND THE ARCHITECTURAL FLOOR PLANS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT.
- SEE LIFE SAFETY PLANS FOR THE LOCATIONS OF SMOKE BARRIERS, SMOKE PARTITIONS AND FIRE-RATED PARTITIONS.
- REFER TO UNDERWRITERS LABORATORIES, INC. FIRE RESISTANCE VOLUMES - CURRENT EDITION FOR SPECIFIC CONSTRUCTION REQUIREMENTS OF U.L. LISTED ASSEMBLIES.
- REFER TO MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR TYPICAL U.L. LISTED PENETRATIONS THROUGH FIRE-RATED ASSEMBLIES. CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING APPROPRIATE PROJECT-SPECIFIC U.L. LISTED ASSEMBLIES FOR PENETRATIONS.
- REFER TO DETAIL FOR TYPICAL WALL FRAMING FOR FIRE DAMPERS IN RATED WALLS. COORDINATE EXACT FRAMING REQUIREMENTS WITH FIRE DAMPER MANUFACTURER. (COORDINATE ALL PARTITION CONSTRUCTION WITH MECHANICAL PRIME CONTRACTOR PRIOR TO COMMENCING PARTITION CONSTRUCTION).
- AT ALL EXISTING AND CONSTRUCTED PARTITIONS THE CONTRACTOR IS TO MAINTAIN THE FIRE-RESISTIVE INTEGRITY.

KEY PLAN

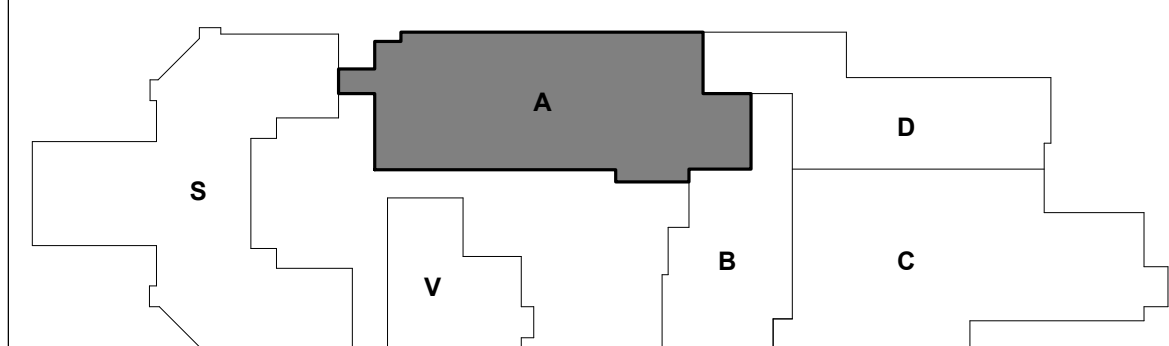

TRUE
NORTH


REVISIONS:

No.	Description	Date
7	Addenda 1-4 Items	2-19-20
9	BULLETIN #2 - VE ITEMS	4-6-2020
11	BULLETIN #4	5-5-20
12	BULLETIN #5	5-18-20
13	BULLETIN #6	6-17-20
19	BULLETIN #12	1-11-21

PROJECT: PFA/1956/LS3P: 3201-186120
DATE: JANUARY 6, 2020

DIMENSION PLAN
LEVEL 1 - A

A-101A.D

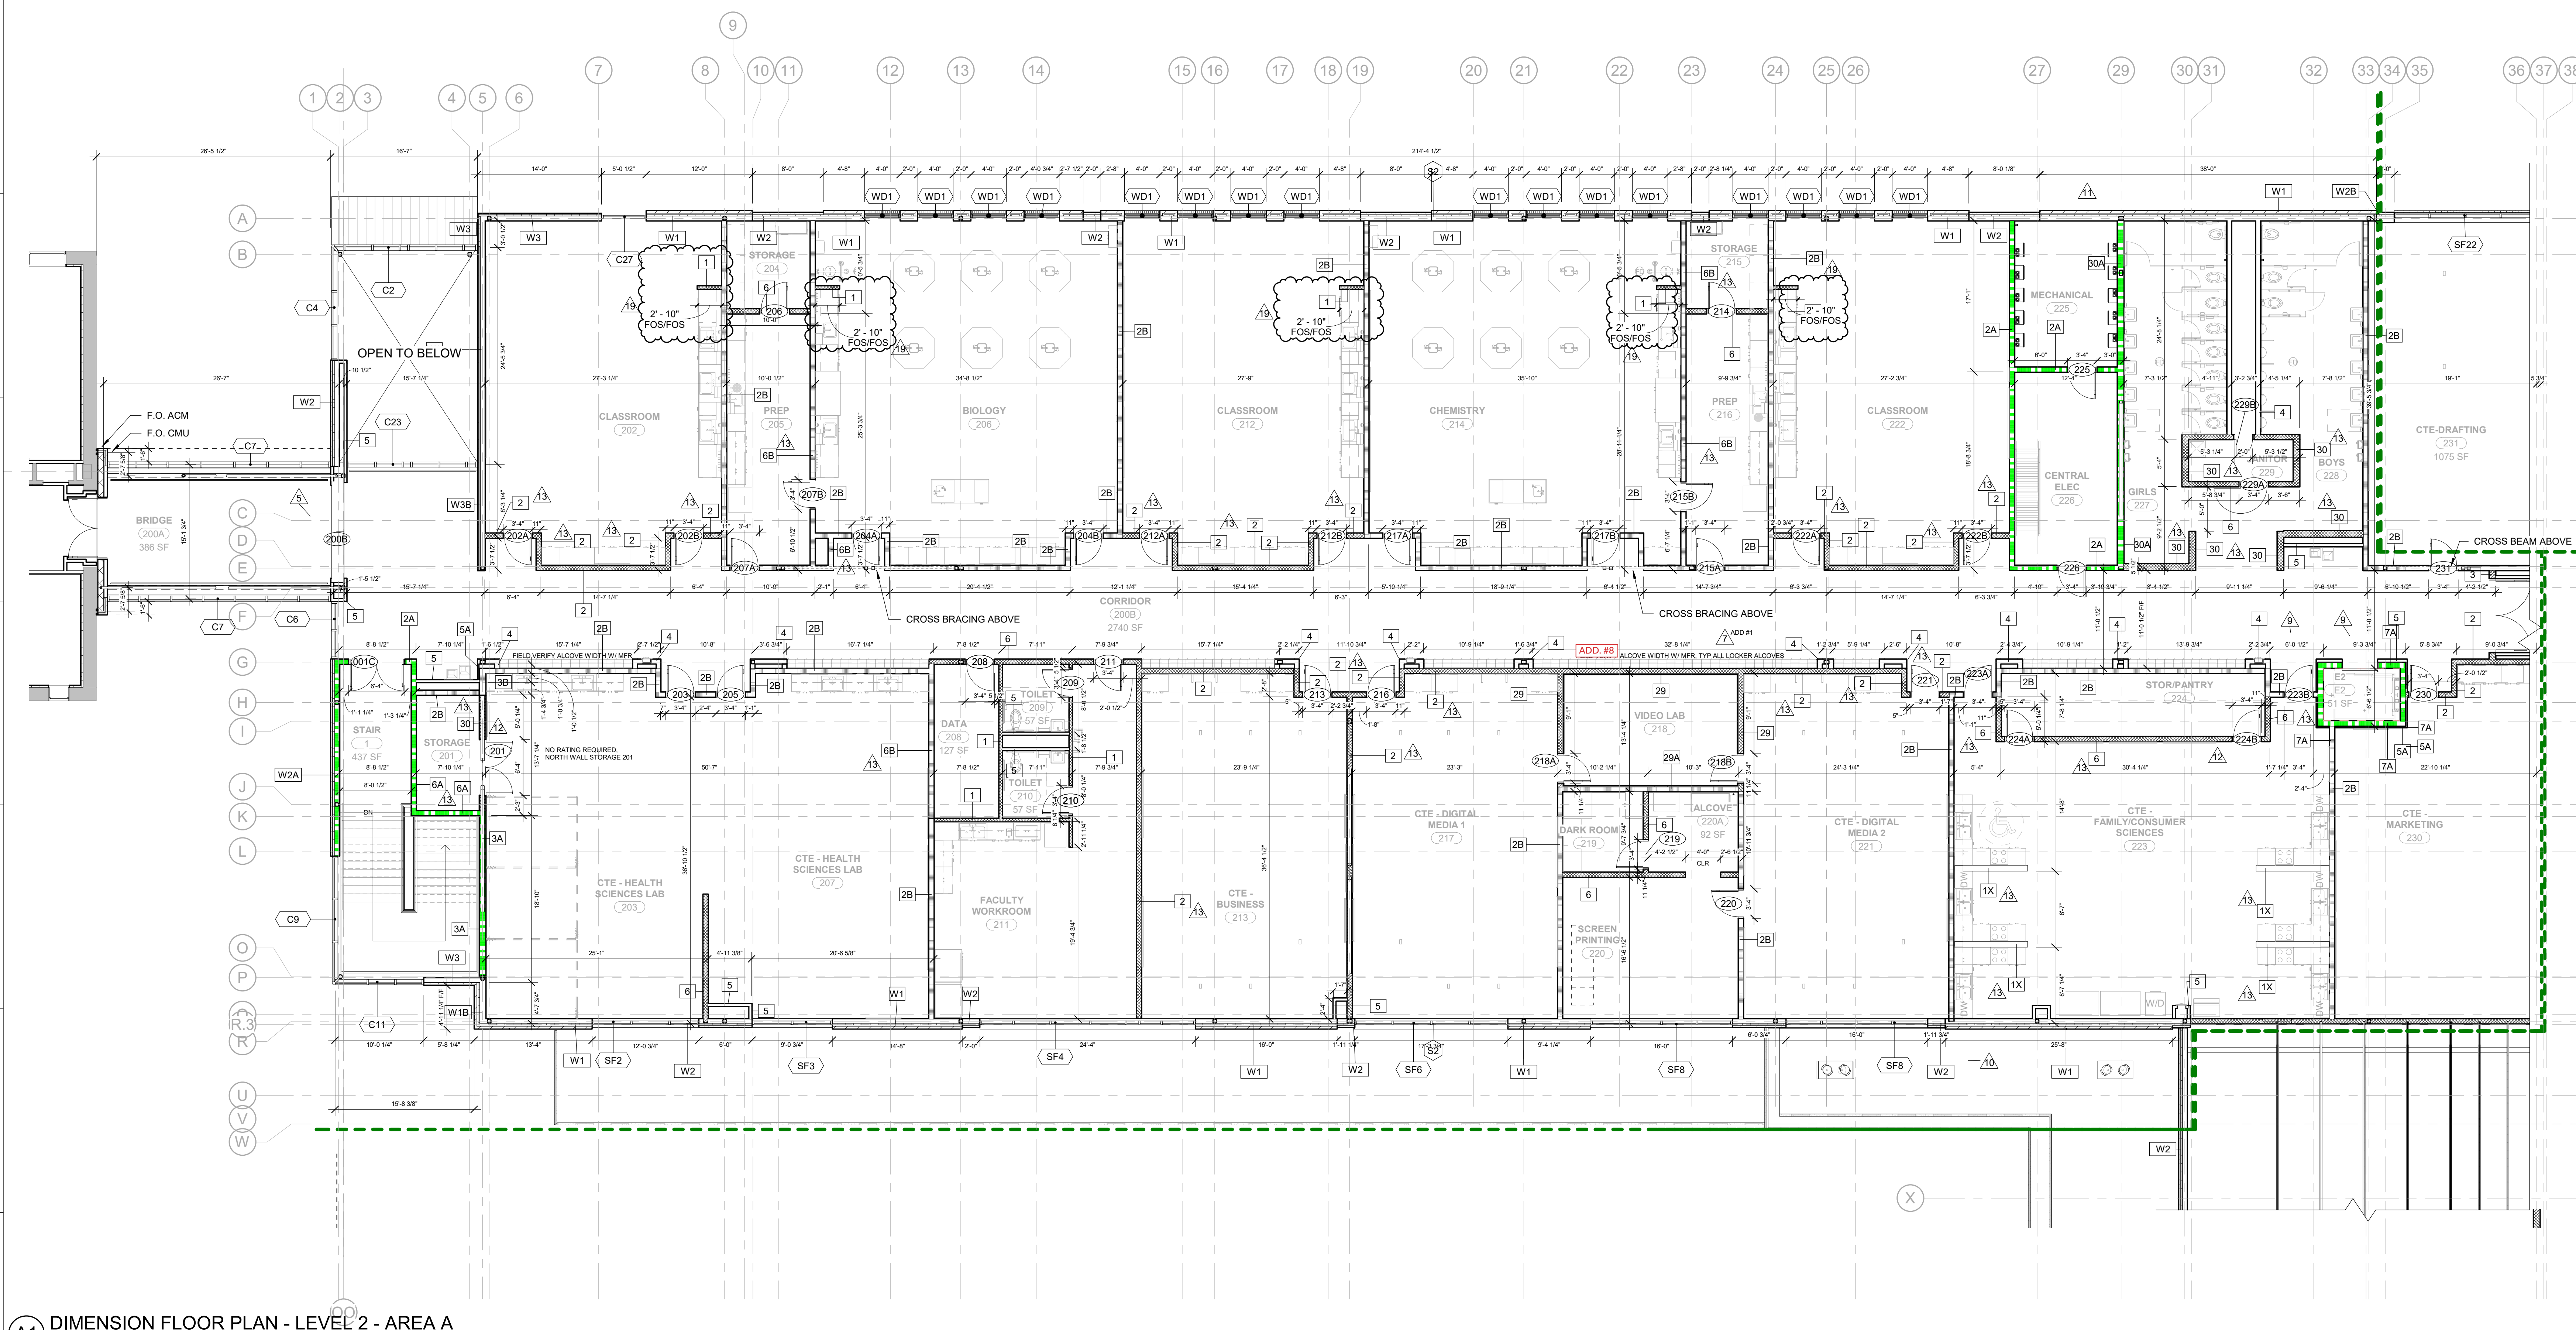

A1 DIMENSION FLOOR PLAN - LEVEL 2 - AREA A
1/8" = 1'-0"

DIMENSION PLAN SHEET NOTES

- EXTERIOR DIMENSIONS AT MASONRY VENEER ARE TO FACE OF VENEER.
- EXTERIOR DIMENSIONS AT STUD WALLS ARE TO FACE OF VENEER.
- INTERIOR DIMENSIONS INDICATED ARE TO (FACE OF CMU, FACE OF STUD, PARTITION CENTERLINE) AND CENTERLINES OF COLUMNS, UNO.
- LOCATE DOOR OPENINGS 4" FROM NEAREST PERPENDICULAR WALL.
- FIRE RATED WALLS/PARTITIONS TO BE CONSTRUCTED TIGHT TO STRUCTURE, PIPING, DUCTWORK AND OTHER PENETRATIONS. ALL WORK IS TO BE BRACED TO STRUCTURE ABOVE.
- WHERE PARTITIONS OF DIFFERENT FIRE RATINGS INTERSECT, THE HIGHEST RATED PARTITION SHALL CONTINUE THROUGH. MAINTAIN PARTITION FIRE RATING BEHIND RECESSED FIRE EXTINGUISHER CABINETS.
- SEE ENLARGED PLANS FOR ADDITIONAL DIMENSIONS AND PARTITION TYPES.
- SEE STRUCTURAL DRAWINGS FOR SLAB DEPRESSIONS AND CUTOUTS.
- SEE BUILDING ELEVATION DRAWINGS FOR LOCATION OF EXTERIOR MASONRY CONTROL JOINTS.

RATED WALLS & PARTITION LEGEND


- 1 HR. RATED FIRE BARRIER TO DECK
- 2 HR. RATED FIRE WALL
- SMOKE PARTITION TO DECK
- NON-RATED PARTITION TO CEILING
- NON-RATED PARTITION TO DECK

NOTE: SEE SHEET A-1003 FOR CONSTRUCTION OF PARTITION TYPES.

PARTITION NOTES

- ALL NON-DESIGNATED PARTITIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT.
- ALL PIPE AND CONDUIT PENETRATIONS THRU RATED PARTITIONS, FLOORS, ROOF, ETC. SHALL BE SEALED WITH A RESPECTIVELY RATED FIRE BARRIER PENETRATION SEALING SYSTEM BY SM OR U.L. APPROVED EQUAL.
- TILE BACKER BOARD SHALL BE USED IN ALL LOCATIONS TO RECEIVE TILE FINISHES. REFER TO FINISH SCHEDULE AND INTERIOR ELEVATIONS FOR LOCATIONS.
- CONTRACTOR SHALL COORDINATE WITH MECHANICAL DUCTWORK PRIOR TO FABRICATION OF PARTITION WALLS.
- SHOULD CONDITIONS OCCUR WHERE A WALL IS UNABLE TO GO STRAIGHT UP TO STRUCTURE DUE TO PIPING, DUCTWORK, ETC., THE PARTITION (GYPSUM BOARD AND FRAMING) MAY JOG HORIZONTALLY ABOVE THE CEILING TO AVOID THE PROBLEM. RATED WALL INTEGRITY SHALL BE MAINTAINED.
- DIMENSIONAL CONFLICTS BETWEEN PARTITION TYPES AND THE ARCHITECTURAL FLOOR PLANS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT.
- SEE LIFE SAFETY PLANS FOR THE LOCATIONS OF SMOKE BARRIERS, SMOKE PARTITIONS AND FIRE-RATED PARTITIONS.
- REFER TO UNDERWRITERS LABORATORIES, INC. FIRE RESISTANCE VOLUMES - CURRENT EDITION FOR SPECIFIC CONSTRUCTION REQUIREMENTS OF U.L. LISTED ASSEMBLIES.
- REFER TO MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR TYPICAL U.L. LISTED PENETRATIONS THROUGH FIRE-RATED ASSEMBLIES.
- CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING APPROPRIATE PROJECT-SPECIFIC U.L. LISTED ASSEMBLIES FOR PENETRATIONS.
- REFER TO DETAIL / / FOR TYPICAL WALL FRAMING FOR FIRE DAMPERS IN RATED WALLS. COORDINATE EXACT FRAMING REQUIREMENTS WITH FIRE DAMPER MANUFACTURER. (COORDINATE ALL PARTITION CONSTRUCTION WITH MECHANICAL PRIME CONTRACTOR PRIOR TO COMMENCING PARTITION CONSTRUCTION).
- AT ALL EXISTING AND CONSTRUCTED PARTITIONS THE CONTRACTOR IS TO MAINTAIN THE FIRE-RESISTIVE INTEGRITY.

KEY PLAN

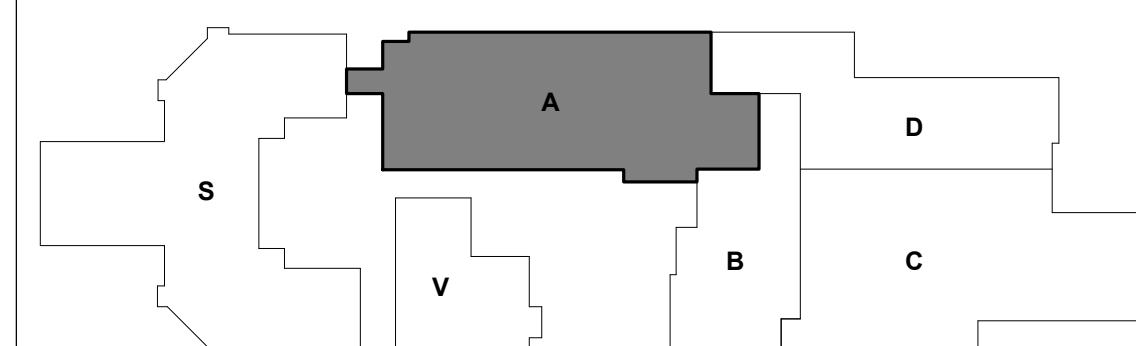

TRUE
NORTH

REVISIONS:

No.	Description	Date
5	Addendum 3	2-5-20
7	Addendum 1-4 Items	2-19-20
9	BULLETIN #2 - VE ITEMS	4-6-2020
10	BULLETIN #3	4-10-20
11	BULLETIN #4	5-5-20
12	BULLETIN #5	5-18-20
13	BULLETIN #6	6-17-20
19	BULLETIN #12	1-11-21

PROJECT: PFA/1956 / LS3P: 3201-186120
DATE: JANUARY 6, 2020

DIMENSION PLAN
LEVEL 2 - A

A-102A.D



HENDERSONVILLE
HIGH SCHOOL
CAMPUS
RENOVATIONS

pfa
architects, p.a.
architecture • planning • interiors
196 COXE AVENUE, ASHEVILLE NC 28801
TEL. 828.254.1963 FAX 828.253.3397
WWW.PFARCHITECTS.COM

LS3P
110 WEST NORTH STREET SUITE 300
GREENVILLE, SOUTH CAROLINA 29601
TEL. 864.235.0405 FAX 864.233.4027
WWW.LS3P.COM



MEMBERS OF THE AMERICAN INSTITUTE OF ARCHITECTS
COPYRIGHT 2019 ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS AND
DOCUMENTATION MAY NOT BE REPRODUCED
IN ANY FORM WITHOUT WRITTEN PERMISSION
FROM PFA ARCHITECTS AND LS3P
ASSOCIATES LTD.


REVISIONS:

No.	Description	Date
7	Addenda 1-4 Items	2-19-20
13	BULLETIN #6	6-17-20

PROJECT: PFA: 1956 / LS3P: 3201-186120
DATE: JANUARY 6, 2020

DIMENSION PLAN
LEVEL 2 - D

A-102D.D

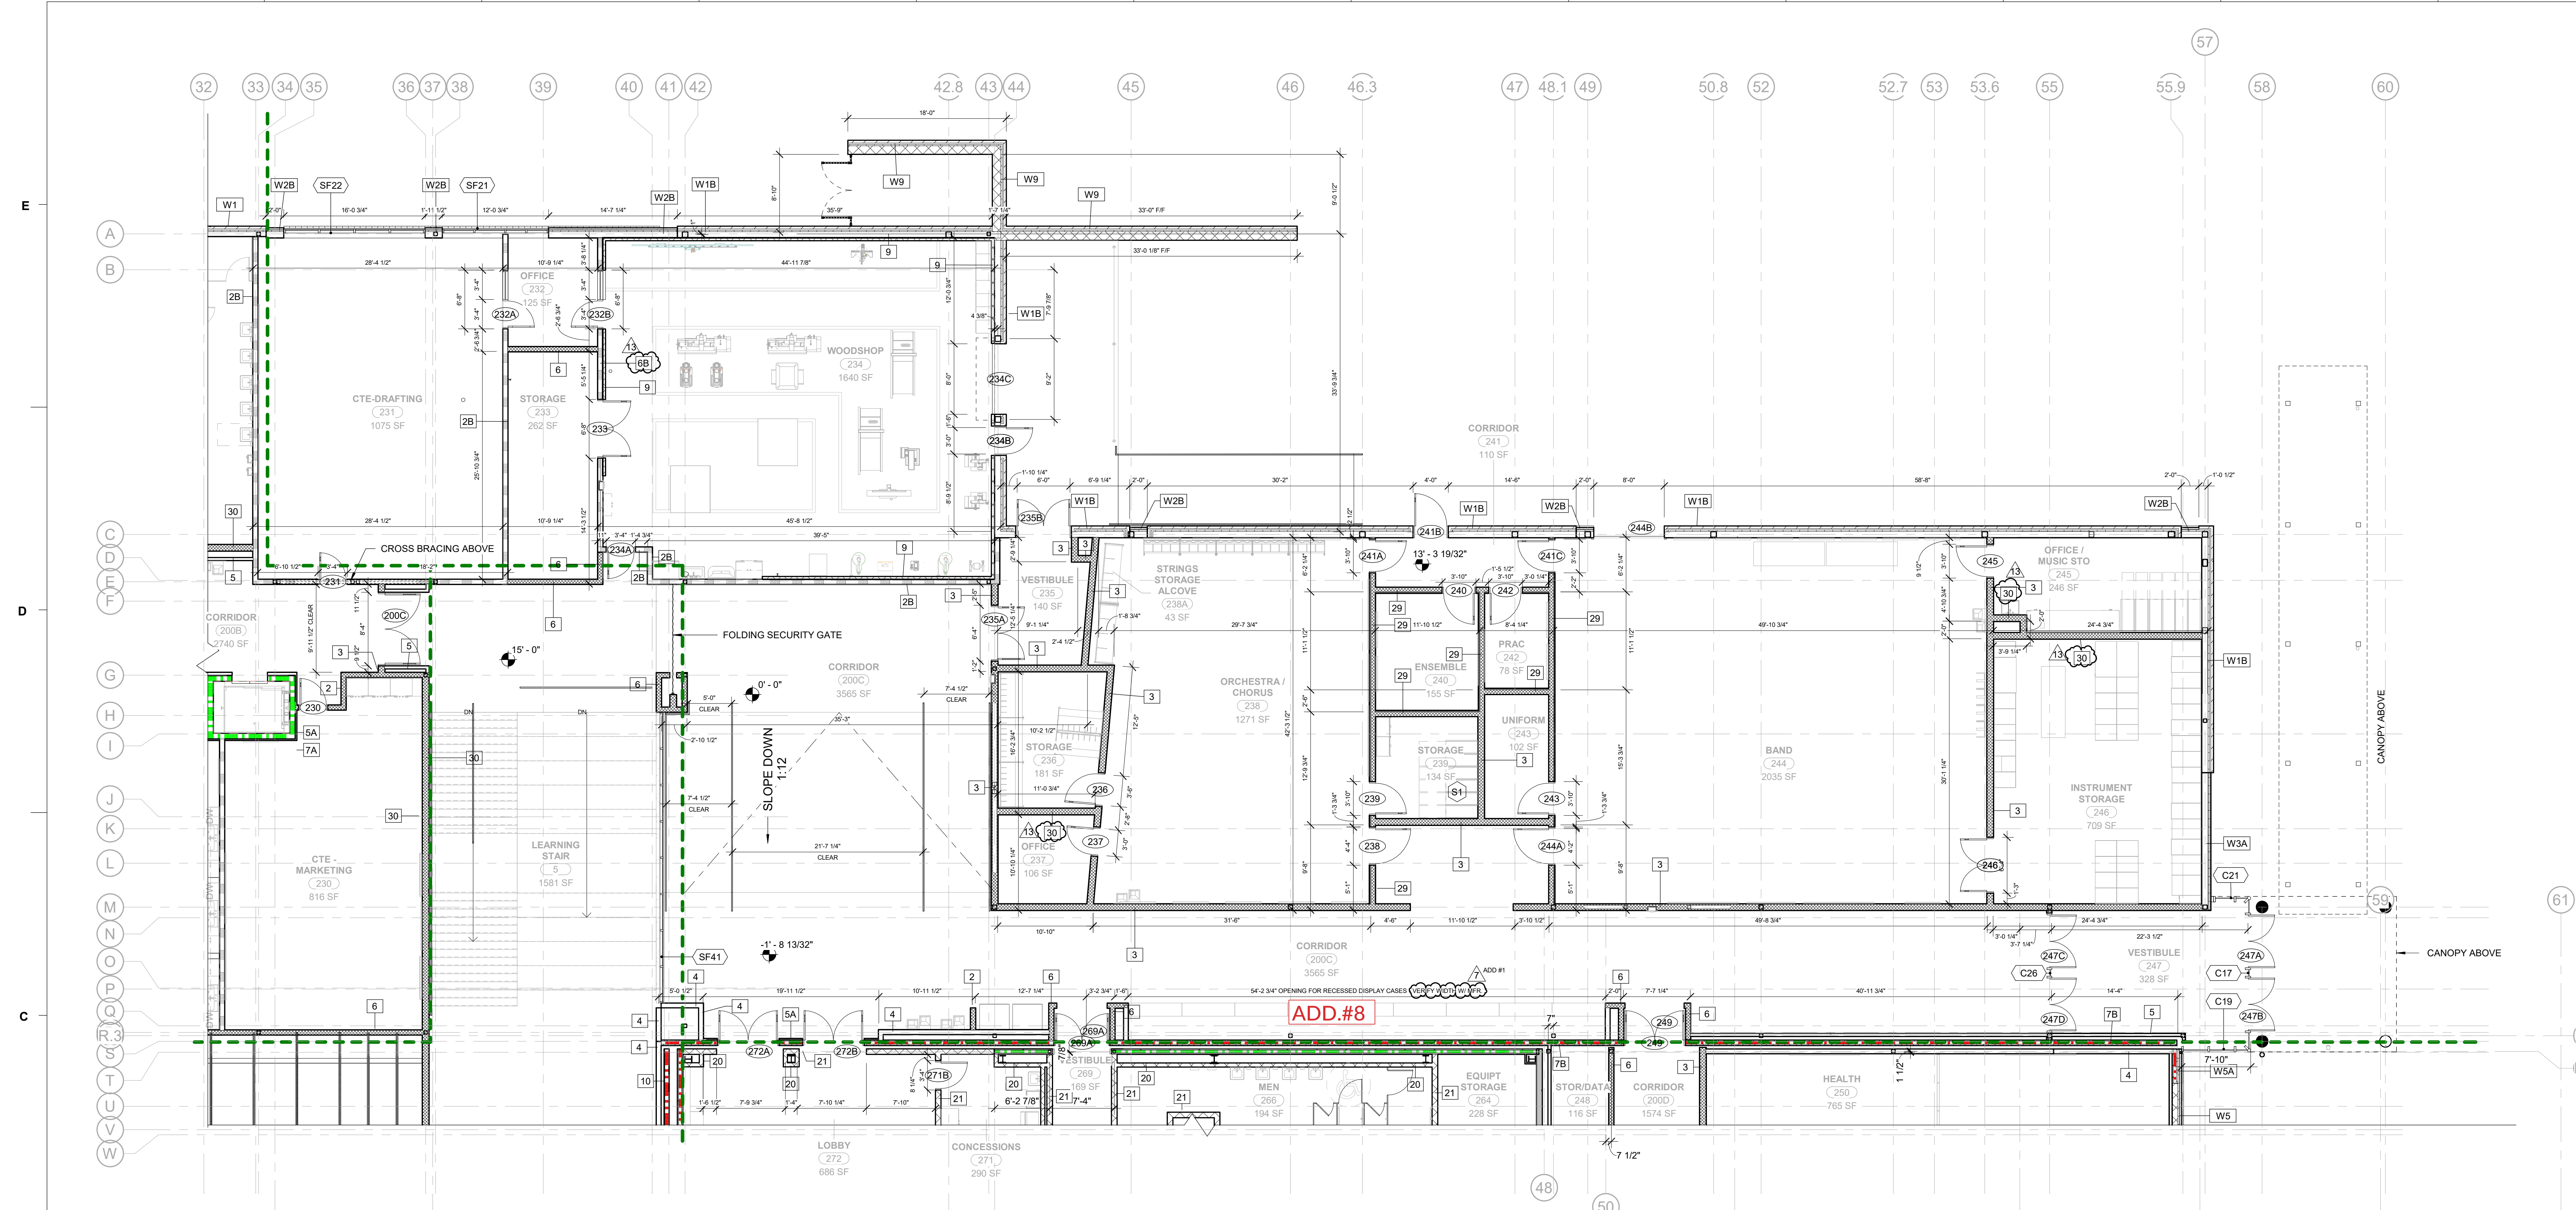

A1 DIMENSION FLOOR PLAN - LEVEL 2 - AREA D
1/8" = 1'-0"

DIMENSION PLAN SHEET NOTES

- EXTERIOR DIMENSIONS AT MASONRY VENEER ARE TO FACE OF VENEER.
- EXTERIOR DIMENSIONS AT STUD WALLS ARE TO FACE OF VENEER.
- INTERIOR DIMENSIONS INDICATED ARE TO FACE OF CMU, FACE OF STUD, PARTITION CENTERLINE) AND CENTERLINES OF COLUMNS, UNO.
- LOCATE DOOR OPENINGS 4" FROM NEAREST PERPENDICULAR WALL.
- FIRE RATED WALLS/PARTITIONS TO BE CONSTRUCTED TIGHT TO STRUCTURE, PIPING, DUCTWORK AND OTHER PENETRATIONS. ALL WORK IS TO BE BRACED TO STRUCTURE ABOVE.
- WHERE PARTITIONS OF DIFFERENT FIRE RATINGS INTERSECT, THE HIGHEST RATED PARTITION SHALL CONTINUE THROUGH. MAINTAIN PARTITION FIRE RATING BEHIND RECESSED FIRE EXTINGUISHER CABINETS.
- SEE ENLARGED PLANS FOR ADDITIONAL DIMENSIONS AND PARTITION TYPES.
- SEE STRUCTURAL DRAWINGS FOR SLAB DEPRESSIONS AND CUTOUTS.
- SEE BUILDING ELEVATION DRAWINGS FOR LOCATION OF EXTERIOR MASONRY CONTROL JOINTS.


RATED WALLS & PARTITION LEGEND

- 1 HR. RATED FIRE BARRIER TO DECK
 - 2 HR. RATED FIRE WALL
 - SMOKE PARTITION TO DECK
 - NON-RATED PARTITION TO CEILING
 - NON-RATED PARTITION TO DECK
- NOTE: SEE SHEET **A.003** FOR CONSTRUCTION OF PARTITION TYPES.


PARTITION NOTES

- ALL NON-DESIGNATED PARTITIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT.
- ALL PIPE AND CONDUIT PENETRATIONS THRU RATED PARTITIONS, FLOORS, ROOF, ETC. SHALL BE SEALED WITH A RESPECTIVELY RATED FIRE BARRIER PENETRATION SEALING SYSTEM BY 3M OR U.L. APPROVED EQUAL.
- TILE BACKER BOARD SHALL BE USED IN ALL LOCATIONS TO RECEIVE TILE FINISHES. REFER TO FINISH SCHEDULE AND INTERIOR ELEVATIONS FOR LOCATIONS.
- CONTRACTOR SHALL COORDINATE WITH MECHANICAL DUCTWORK PRIOR TO FABRICATION OF PARTITION WALLS.
- SHOULD CONDITIONS OCCUR WHERE A WALL IS UNABLE TO GO STRAIGHT UP TO STRUCTURE DUE TO PIPING, DUCTWORK, ETC., THE PARTITION (GYPSUM BOARD AND FRAMING) MAY JOG HORIZONTALLY ABOVE THE CEILING TO AVOID THE PROBLEM. RATED WALL INTEGRITY SHALL BE MAINTAINED.
- DIMENSIONAL CONFLICTS BETWEEN PARTITION TYPES AND THE ARCHITECTURAL FLOOR PLANS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT.
- SEE LIFE SAFETY PLANS FOR THE LOCATIONS OF SMOKE BARRIERS, SMOKE PARTITIONS AND FIRE-RATED PARTITIONS.
- REFER TO UNDERWRITERS LABORATORIES, INC. FIRE RESISTANCE VOLUMES - CURRENT EDITION FOR SPECIFIC CONSTRUCTION REQUIREMENTS OF U.L. LISTED ASSEMBLIES.
- REFER TO MECHANICAL ELECTRICAL AND PLUMBING DRAWINGS FOR TYPICAL U.L. LISTED PENETRATIONS THROUGH FIRE-RATED ASSEMBLIES. CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING APPROPRIATE PROJECT-SPECIFIC U.L. LISTED ASSEMBLIES FOR PENETRATIONS.
- REFER TO DETAIL FOR TYPICAL WALL FRAMING FOR FIRE DAMPERS IN RATED WALLS. COORDINATE EXACT FRAMING REQUIREMENTS WITH FIRE DAMPER MANUFACTURER. (COORDINATE ALL PARTITION CONSTRUCTION WITH MECHANICAL PRIME CONTRACTOR PRIOR TO COMMENCING PARTITION CONSTRUCTION).
- AT ALL EXISTING AND CONSTRUCTED PARTITIONS THE CONTRACTOR IS TO MAINTAIN THE FIRE-RESISTIVE INTEGRITY.

KEY PLAN

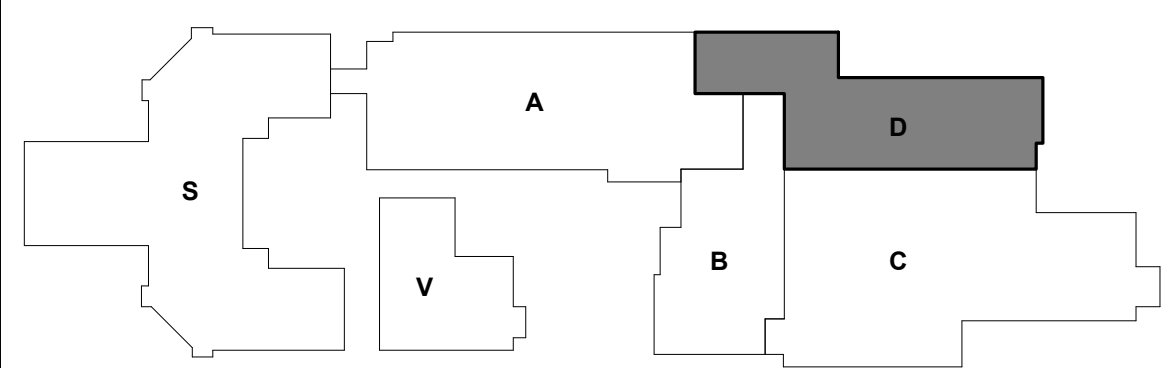

B:\362\Hendersonville High School\ARCH_LHS_CENTRAL_2018.rvt
4/10/2020 11:07:05 AM

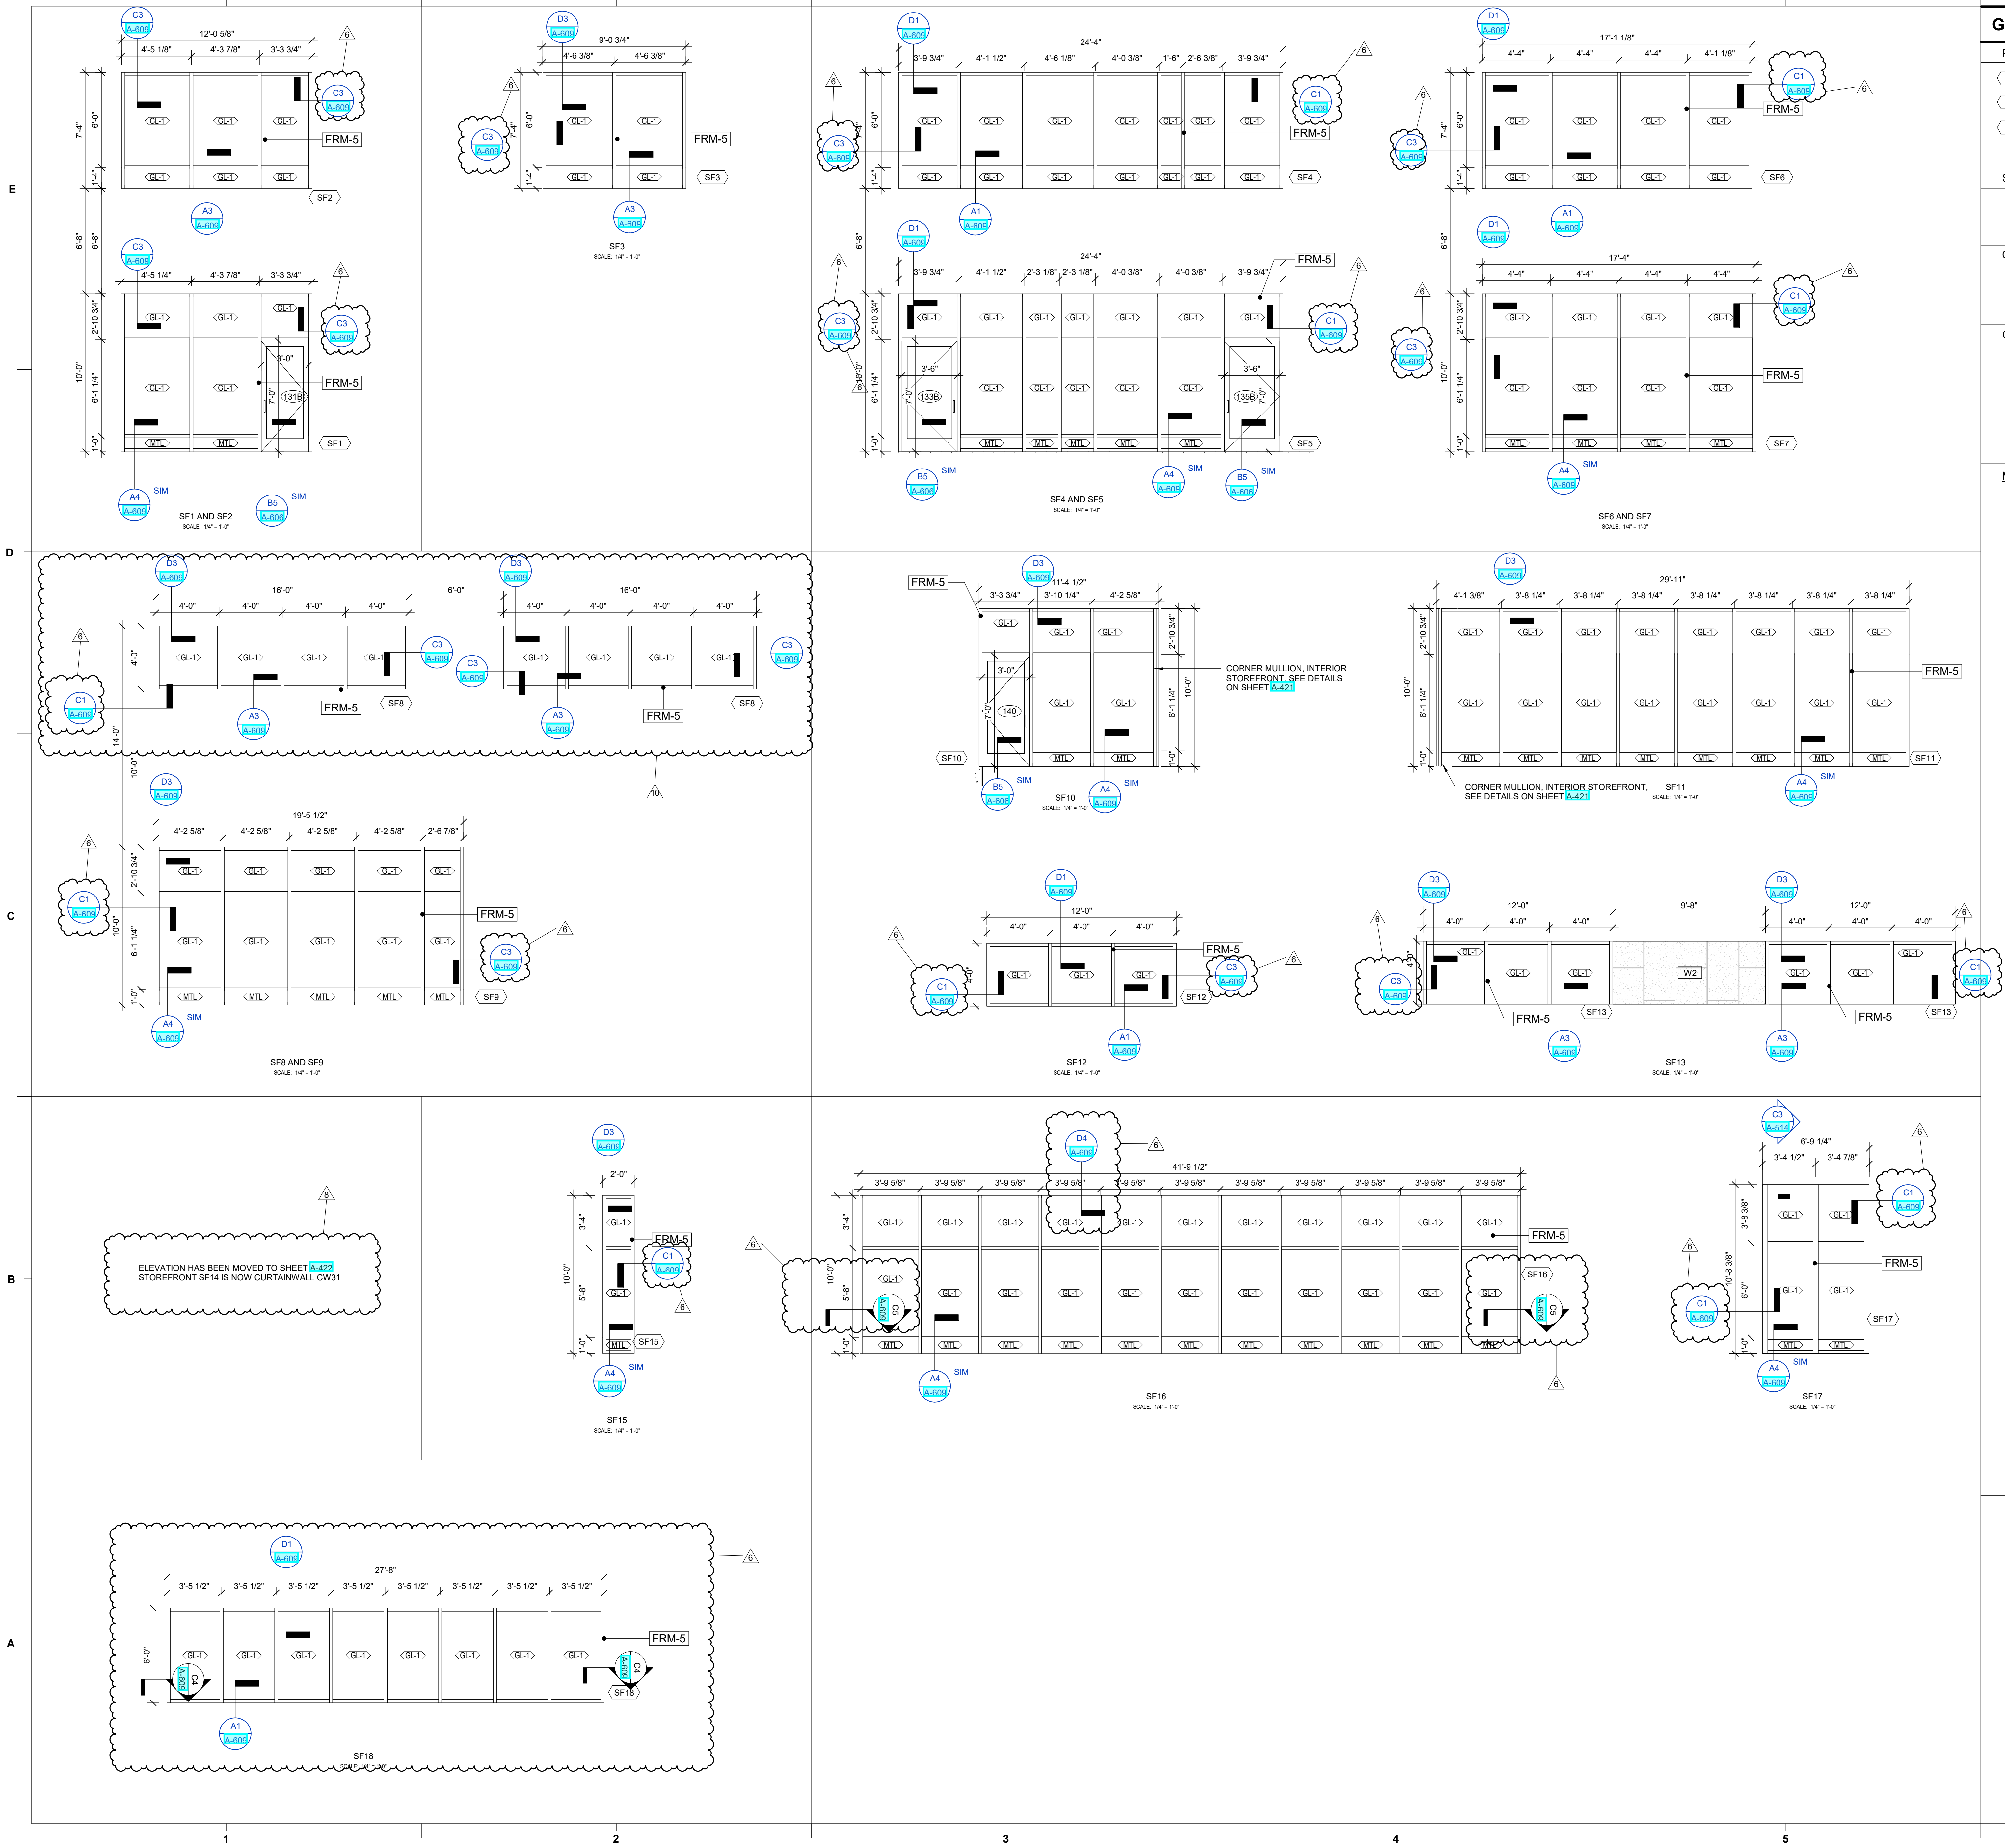

GLAZING NOTES AND LEGEND

FLOOR PLAN TAGS

- C1 CURTAIN WALL, NEW ADDITION
- SF1 STOREFRONT, NEW ADDITION
- WD1 ALUMINUM WINDOW, NEW ADDITION
- SC1 CURTAIN WALL, STILLWELL
- WS1 ALUMINUM WINDOW, STILLWELL

STOREFRONT FRAME TYPES

- FRM-4 FRAME SIZE: 2" x 4-1/2"
- FRM-5 FRAME SIZE: 2" x 5-1/2"

CURTAIN WALL FRAME TYPES

- FRM-6 FRAME SIZE: 2-1/2" x 6-3/4"
- FRM-7 FRAME SIZE: 2-1/2" x 7-1/2"

GLAZING PANEL TYPES

- GL-1 1" TEMPERED INSULATING GLASS
- GL-2 1" TEMPERED INSULATING GLASS W/ FILM
- GL-3 1" TEMPERED INSULATING GLASS WITH COLOR INTERLAYER
- GL-4 1/4" CLEAR TEMPERED GLASS
- GL-5 1/4" CLEAR TEMPERED GLASS WITH FILM
- GL-6 SPANDREL MTL TO MATCH CW/SF FRAME
- GL-7 1" SPANDREL INSULATING GLASS

NOTES

- ALL GLAZING TO BE TEMPERED, U.N.O.
- CURTAINWALL & STOREFRONT FRAME FINISH TO BE CLEAR ANODIZED TYPICAL EXCEPT AS NOTED BELOW. REFER TO SPECIFICATIONS FOR FULL DESCRIPTION OF FINISH.
- CURTAINWALL FINISH AT STILLWELL BUILDING SHALL BE 70% PVDF, COLOR MATCHED TO ALUMINUM WINDOWS. REFER TO SPECIFICATIONS FOR FULL DESCRIPTION OF FINISH.
- REFER TO DOOR SCHEDULES FOR DOOR INFORMATION.



HENDERSONVILLE HIGH SCHOOL CAMPUS RENOVATIONS



196 COXE AVENUE, ASHEVILLE NC 28801
TEL. 828.234.1963 FAX 828.233.3307
WWW.PFARCHITECTS.COM



110 WEST NORTH STREET SUITE 300
GREENVILLE, SOUTH CAROLINA 29601
TEL. 864.235.0405 FAX 864.233.4027
WWW.LS3P.COM



MEMBERS OF THE AMERICAN INSTITUTE OF ARCHITECTS
COPYRIGHT 2019 ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS AND
DOCUMENTATION MAY NOT BE REPRODUCED
IN ANY FORM WITHOUT WRITTEN PERMISSION
FROM PFA ARCHITECTS AND LS3P
ASSOCIATES LTD.

REVISIONS:

No.	Description	Date
6	Addendum 4	2-10-20
8	BULLETIN #1	3-5-20
10	BULLETIN #3	4-10-20

PROJECT: PFA: 1956 / LS3P: 3201-186120
DATE: JANUARY 6, 2020

GLAZING ELEVATIONS - STOREFRONT

A-423



HENDERSONVILLE
HIGH SCHOOL
CAMPUS
RENOVATIONS



MEMBERS OF THE AMERICAN INSTITUTE OF ARCHITECTS
COPYRIGHT 2019 ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS AND
DOCUMENTATION MAY NOT BE REPRODUCED
IN ANY FORM WITHOUT WRITTEN PERMISSION
FROM PFA ARCHITECTS AND LS3P
ASSOCIATES LTD.

REVISIONS:		
No.	Description	Date
6	Addendum 4	2-10-20
9	BULLETIN #2 - VE ITEMS	4-6-2020

PROJECT: PFA: 1956 / LS3P: 3201-186120
DATE: JANUARY 6, 2020

GLAZING
ELEVATIONS -
STOREFRONT

A-424

GLAZING NOTES AND LEGEND

FLOOR PLAN TAGS

- C1 CURTAIN WALL, NEW ADDITION SC1 CURTAIN WALL, STILLWELL
SF1 STOREFRONT, NEW ADDITION
WD1 ALUMINUM WINDOW, NEW ADDITION WS1 ALUMINUM WINDOW, STILLWELL

STOREFRONT FRAME TYPES

- FRM-4 FRAME SIZE: 2' x 4-1/2"
FRM-5 FRAME SIZE: 2' x 5-1/2"

CURTAIN WALL FRAME TYPES

- FRM-6 FRAME SIZE: 2-1/2" x 6-3/4"
FRM-7 FRAME SIZE: 2-1/2" x 7-1/2"


GLAZING PANEL TYPES

- GL-1 1" TEMPERED INSULATING GLASS
GL-1B 1" TEMPERED INSULATING GLASS W/ FILM
GL-2 1" TEMPERED INSULATING GLASS WITH COLOR INTERLAYER
GL-3 1/4" CLEAR TEMPERED GLASS
GL-4 1/4" CLEAR TEMPERED GLASS WITH FILM
MTL SPANDREL MTL TO MATCH CW/SF FRAME
SPN 1" SPANDREL INSULATING GLASS

NOTES


- ALL GLAZING TO BE TEMPERED, U.N.O.
- CURTAINWALL & STOREFRONT FRAME FINISH TO BE CLEAR ANODIZED, TYPICAL, EXCEPT AS NOTED BELOW. REFER TO SPECIFICATIONS FOR FULL DESCRIPTION OF FINISH.
- CURTAINWALL FINISH AT STILLWELL BUILDING SHALL BE 70% PVDF, COLOR MATCHED TO ALUMINUM WINDOWS. REFER TO SPECIFICATIONS FOR FULL DESCRIPTION OF FINISH.
- REFER TO DOOR SCHEDULES FOR DOOR INFORMATION.

ADD #108

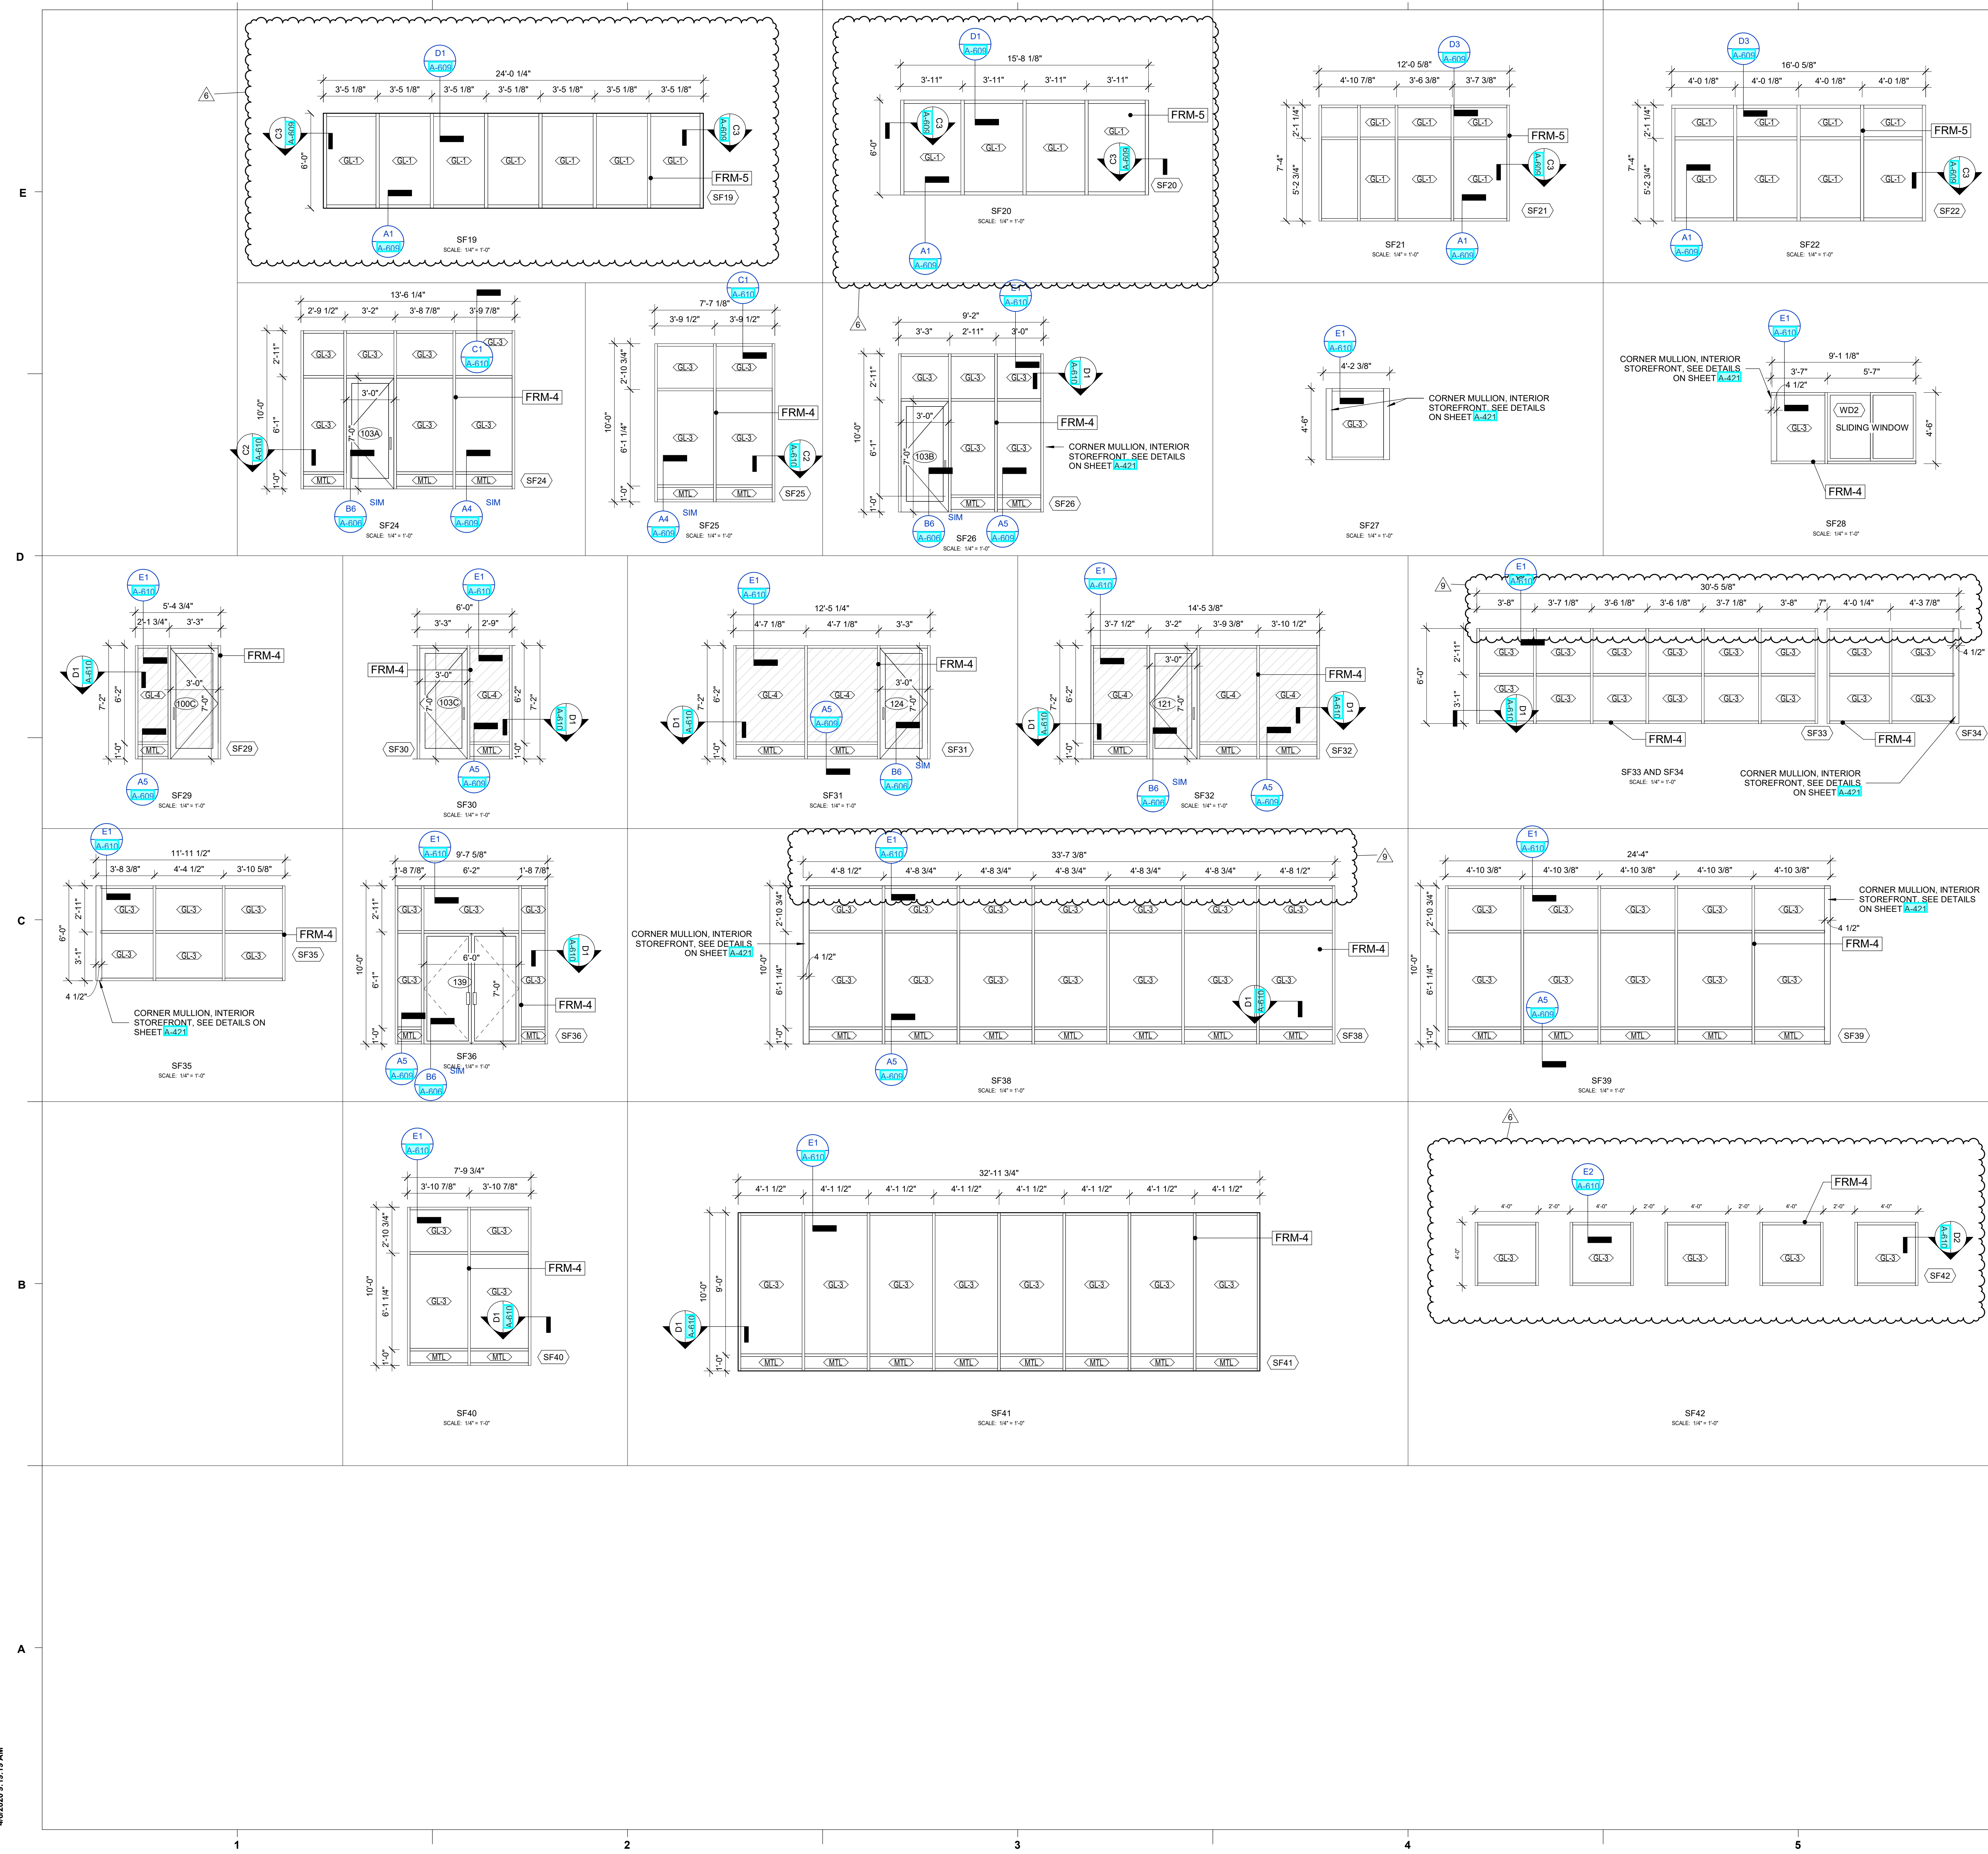


B:\362\Hendersonville High School\ARCH_L_HHS_CENTRAL_2018.rvt
11/02/2020 2:48:58 PM

E

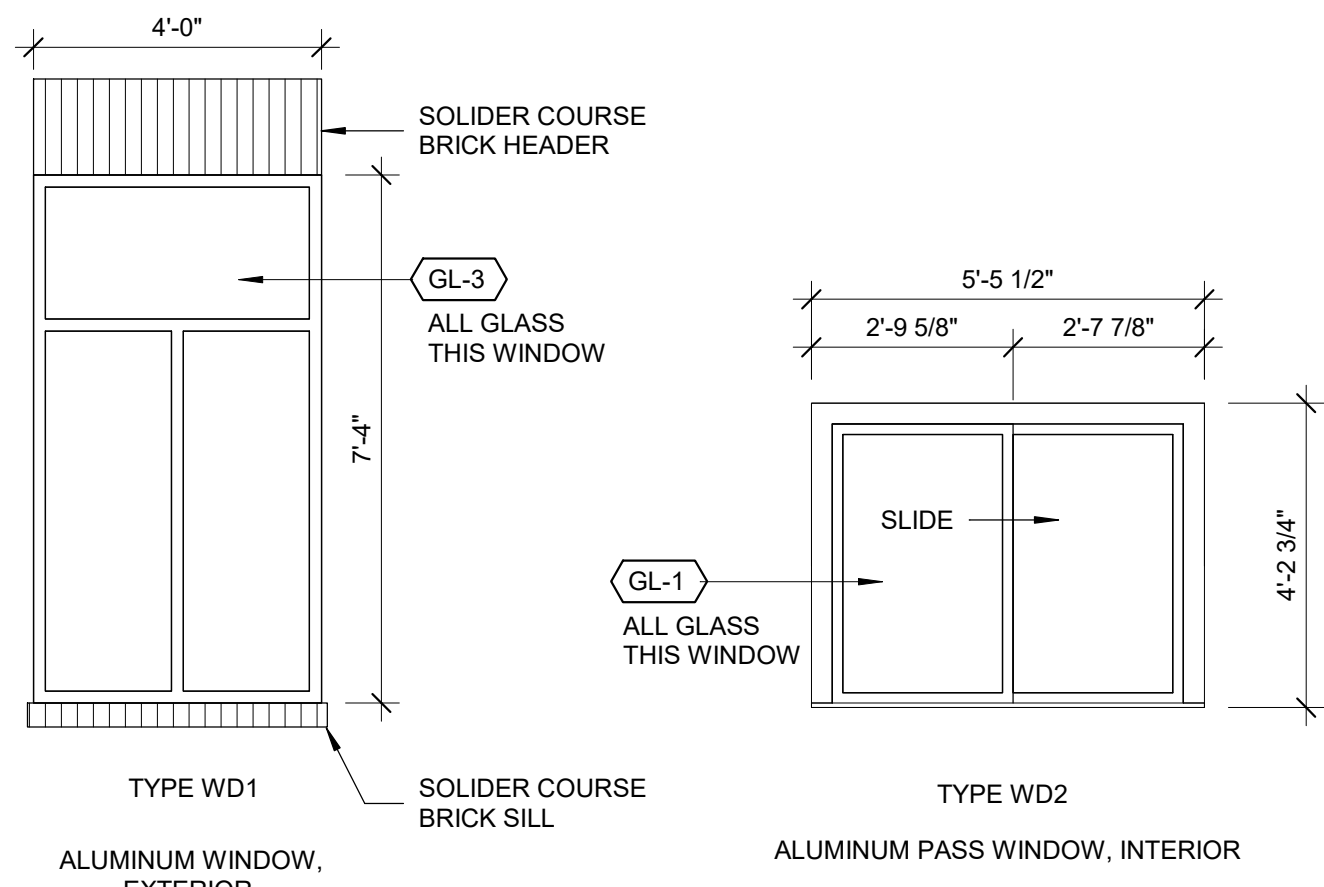

WINDOW TYPES LEGEND - NEW ADDITION
3/8" = 1'-0"

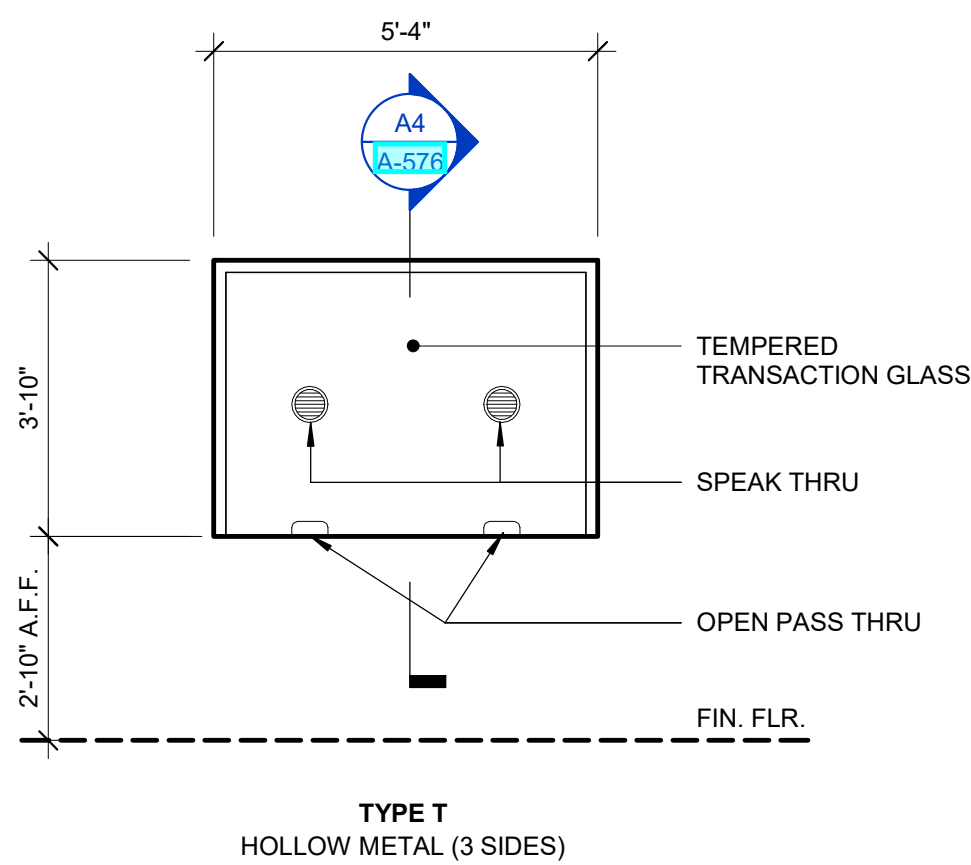

WINDOW TYPES LEGEND - TICKET BOOTH
3/8" = 1'-0"

C

B

A

1


2

3

4

5

6

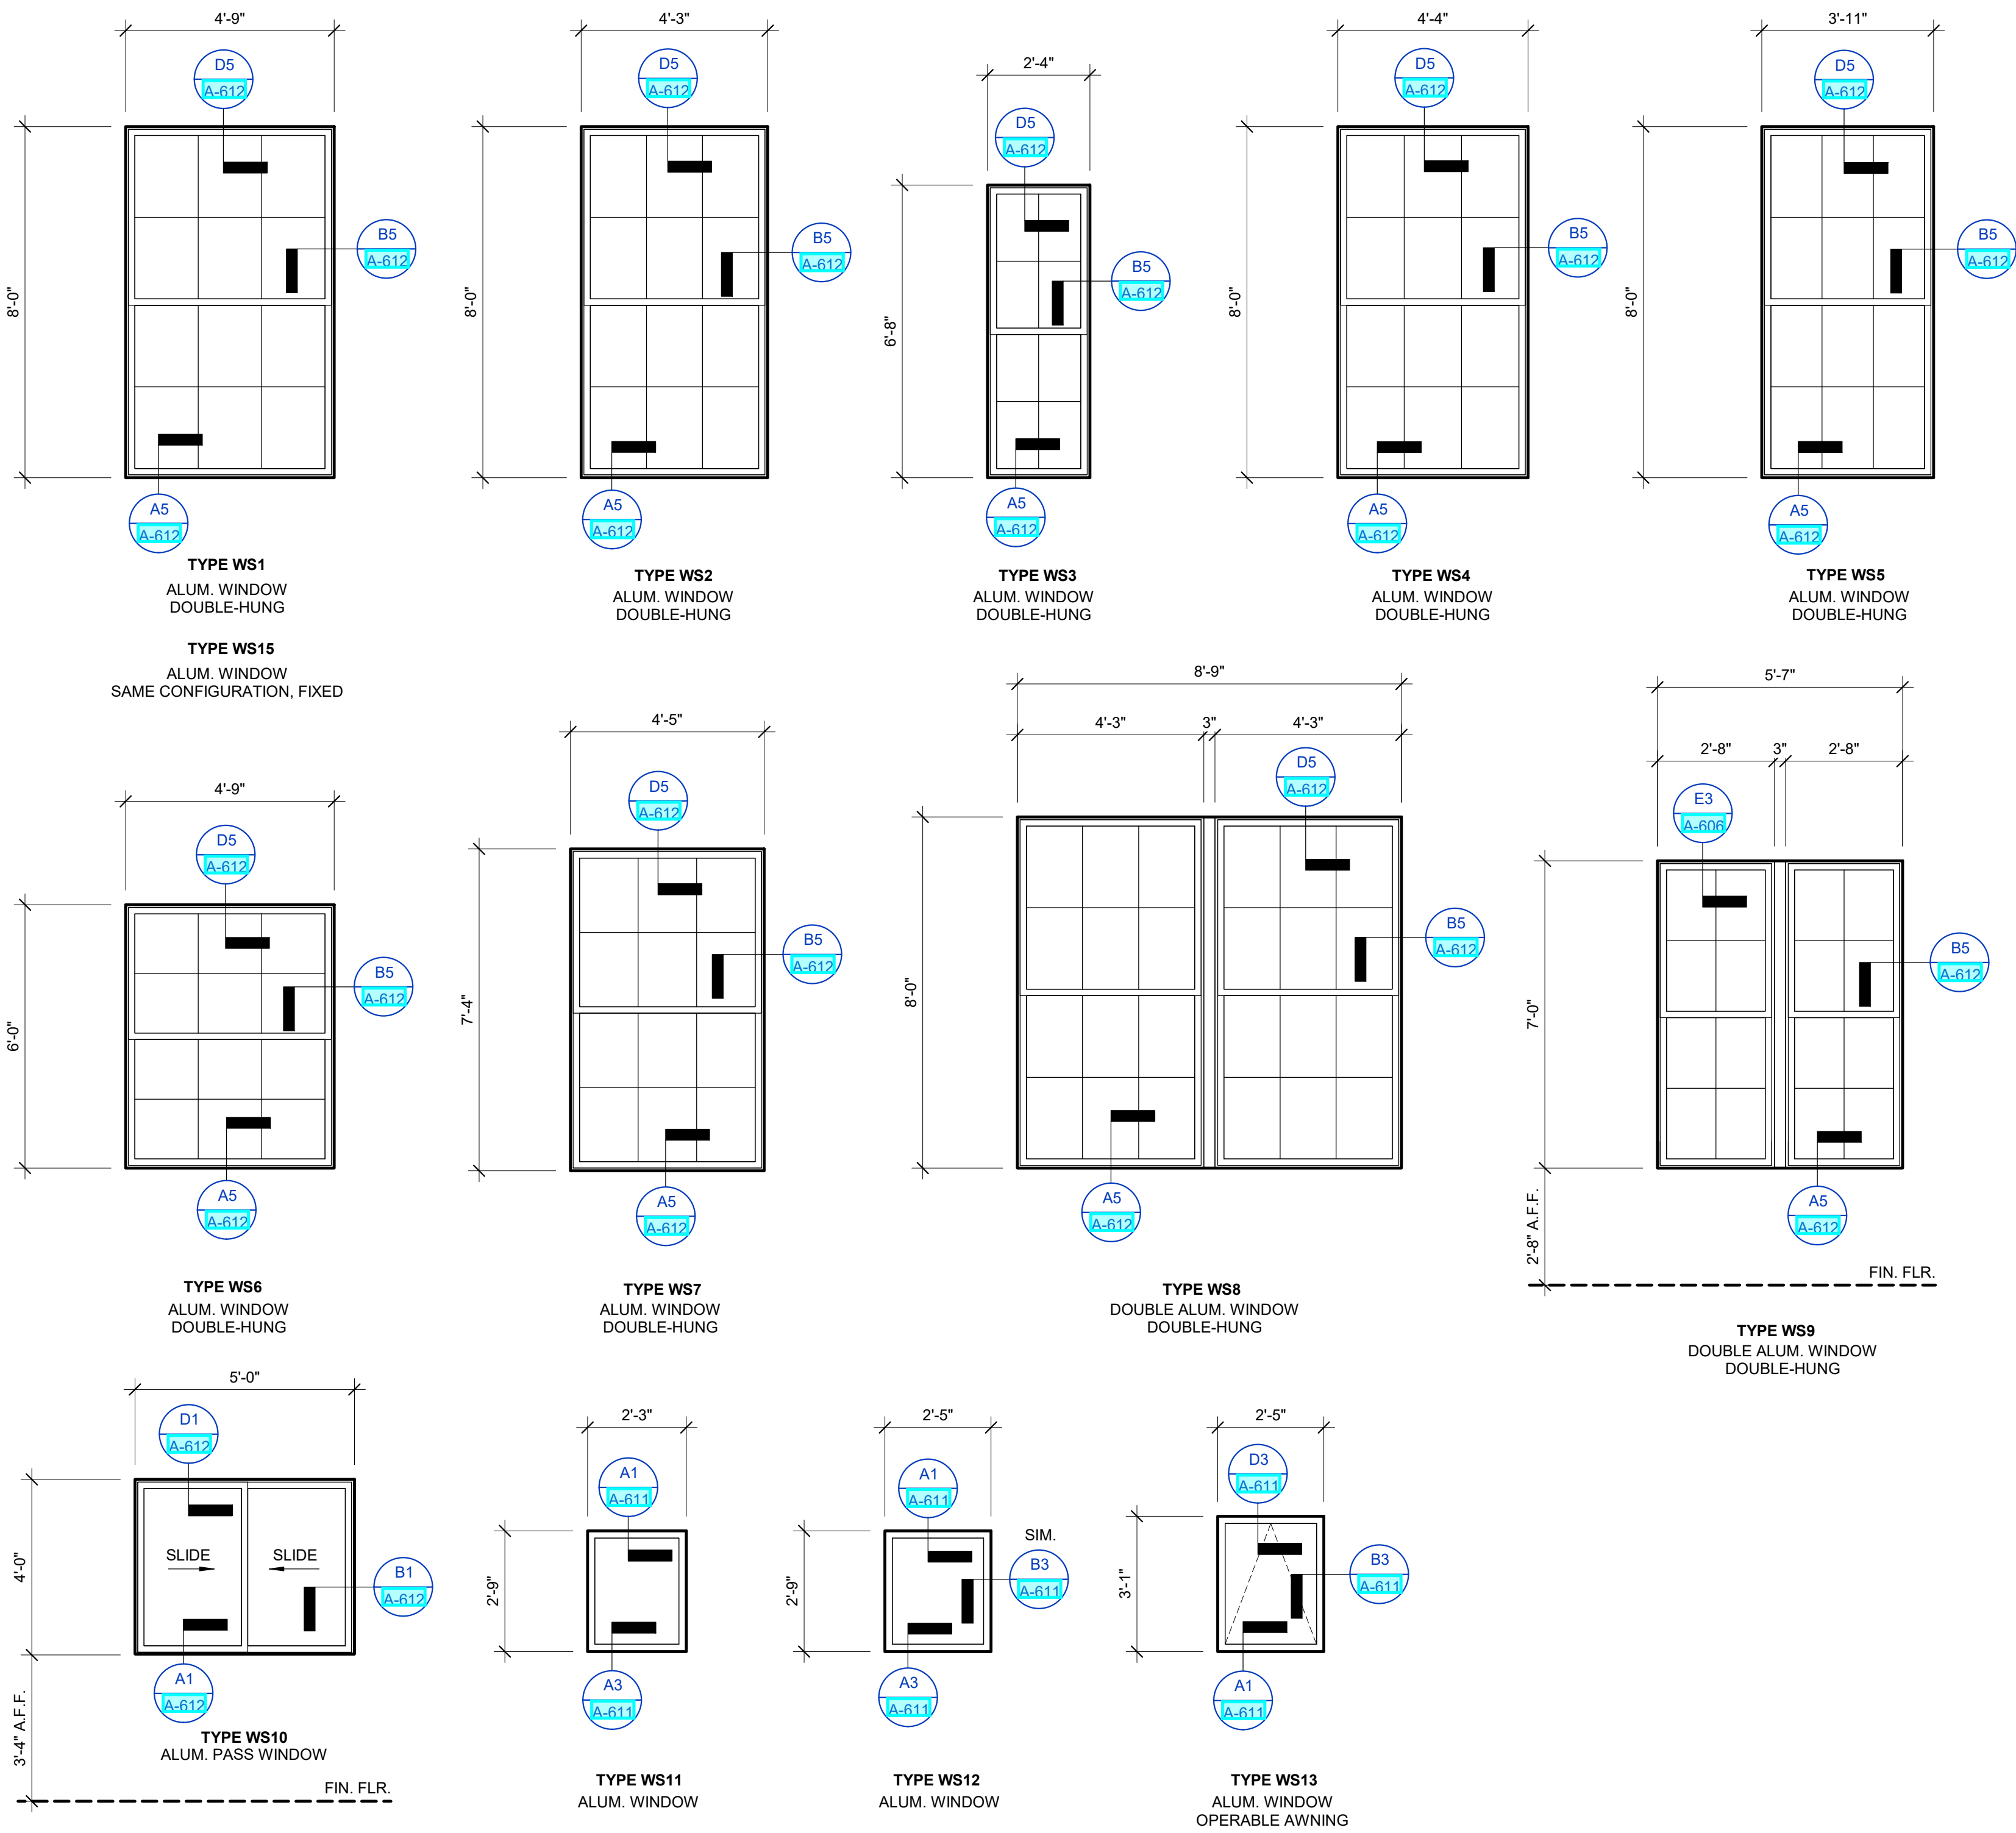


WINDOW TYPES LEGEND - STILLWELL
3/8" = 1'-0"

WINDOW ELEVATION NOTES, STILLWELL

1. GLAZING TYPE AT EXTERIOR WINDOWS SHALL BE GL-1.
2. GLAZING TYPE AT INTERIOR WINDOWS SHALL BE GL-3.
3. FINISH AT EXTERIOR STILLWELL WINDOWS SHALL BE 70% PVDF, AAMA 2605.
4. ALL INTERIOR SILLS SHALL BE SOLID SURFACE, TYPE SS-3. [REFER](#) TO FINISH SCHEDULE AT SHEET [AS-729](#).
5. STILLWELL WINDOW TYPES WITH A.F.F. DIMENSIONS ARE NEW WINDOWS IN NEW OPENINGS. ALL OTHERS ARE REPLACEMENT WINDOWS IN EXISTING OPENINGS. FIELD VERIFY WOPENING SIZES PRIOR TO FABRICATION.



HENDERSONVILLE HIGH SCHOOL CAMPUS RENOVATIONS

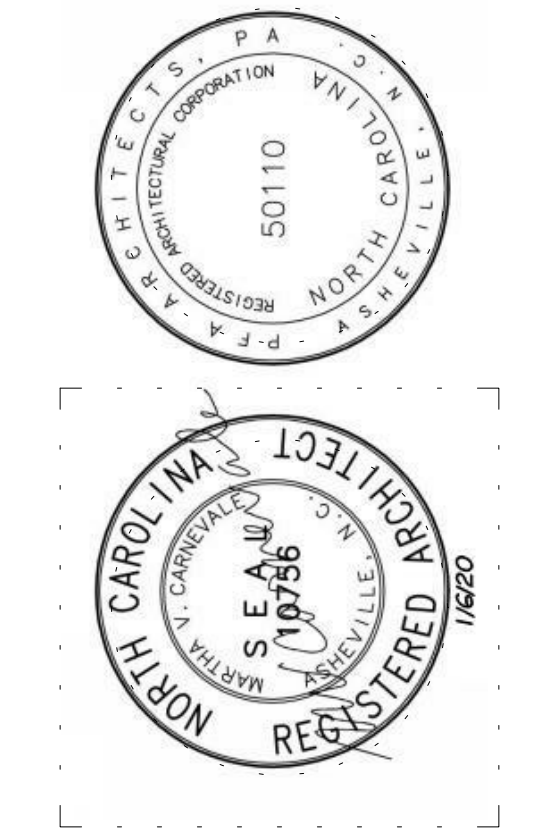

MEMBERS OF THE AMERICAN INSTITUTE OF ARCHITECTS
COPYRIGHT 2019 ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS AND
DOCUMENTATION MAY NOT BE REPRODUCED
IN ANY FORM WITHOUT WRITTEN PERMISSION
FROM PFA ARCHITECTS AND LS3P
ASSOCIATES LTD.

REVISIONS:		
No.	Description	Date

PROJECT: PFA: 1956 / LS3P: 3201-186120
DATE: JANUARY 6, 2020

WINDOW SCHEDULE & WINDOW TYPE LEGEND

A-605

CONSTRUCTION DOCUMENTS